




PLAN VIEW SHOWING GENERAL LAYOUT  
SCALE 1:25

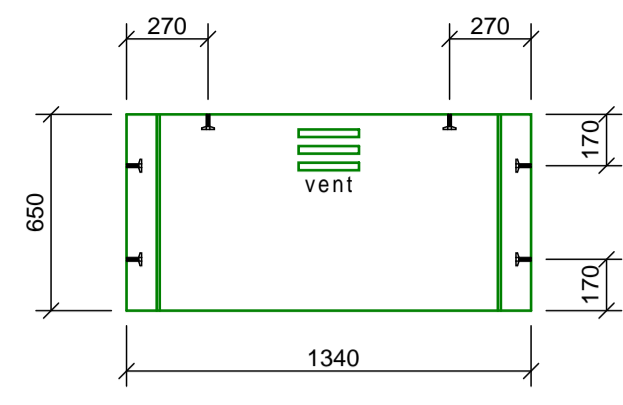


BACK TOP PANEL  
SCALE 1:25

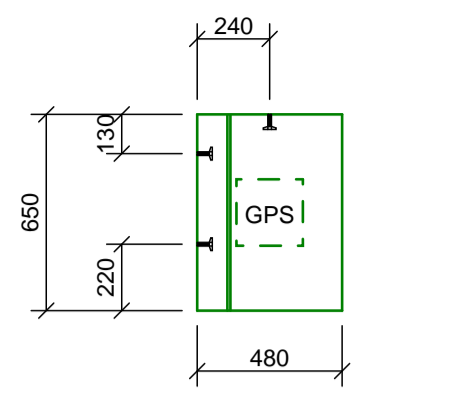


FRONT TOP PANEL  
SCALE 1:25

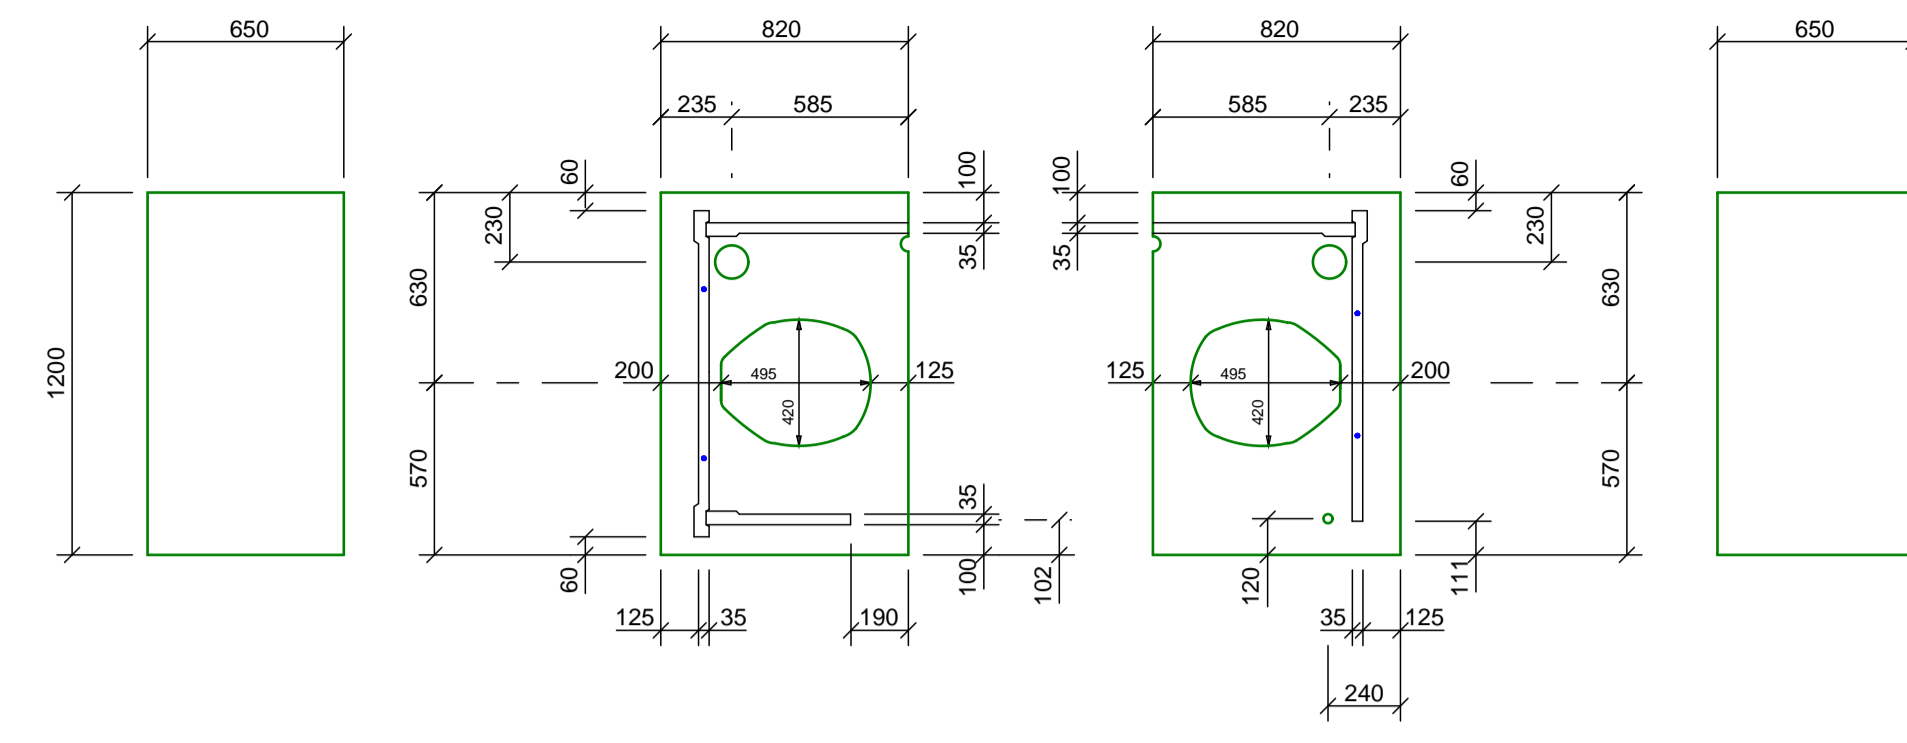


PLAN VIEW ON COVER SLABS  
SCALE 1:10

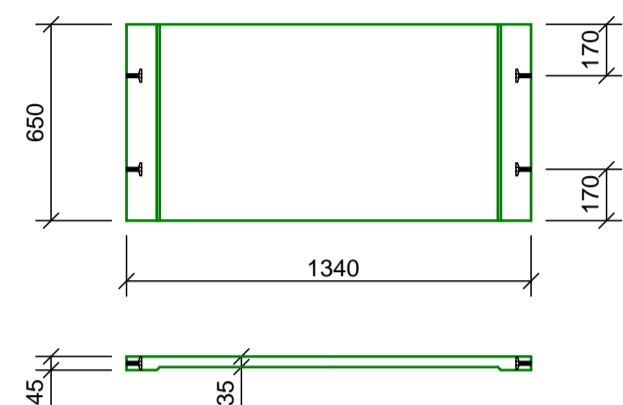


BACK MIDDLE PANEL  
SCALE 1:25

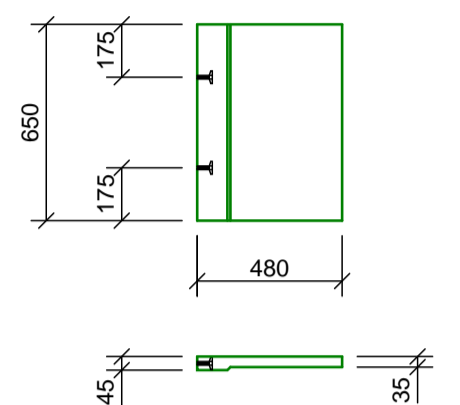


FRONT MIDDLE PANEL  
SCALE 1:25

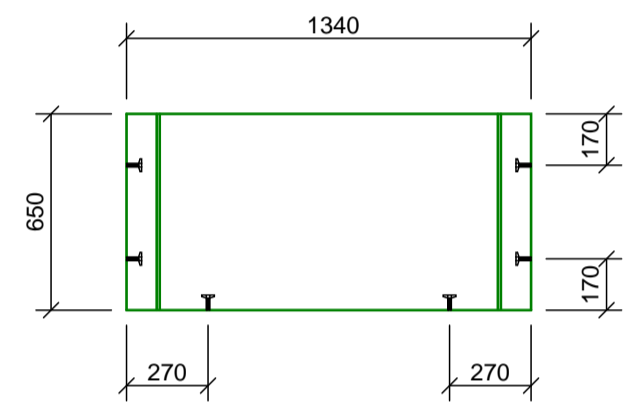


BACK BOTTOM PANEL  
SCALE 1:25

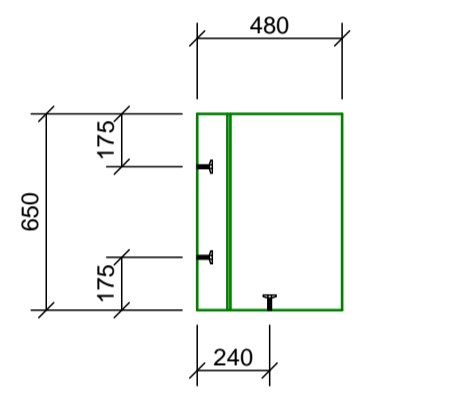


FRONT BOTTOM PANEL  
SCALE 1:25

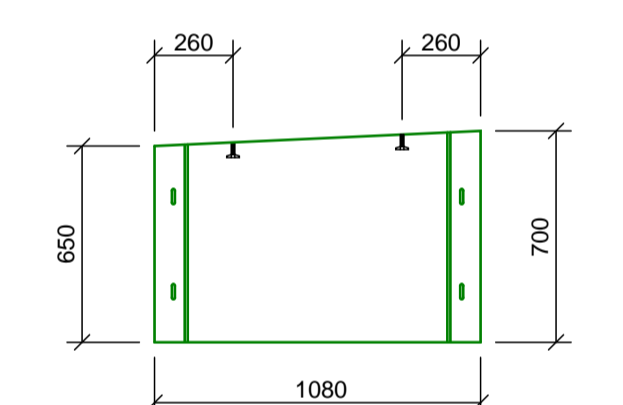


LEFT SIDE TOP PANEL  
SCALE 1:25

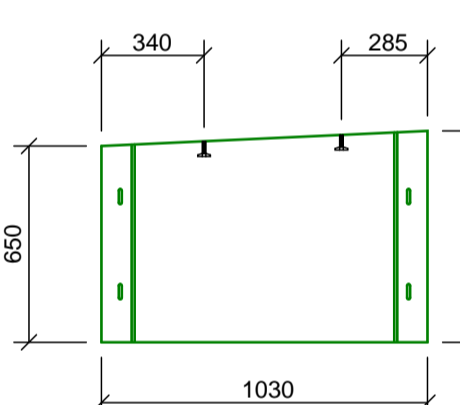


RIGHT SIDE TOP PANEL  
SCALE 1:25

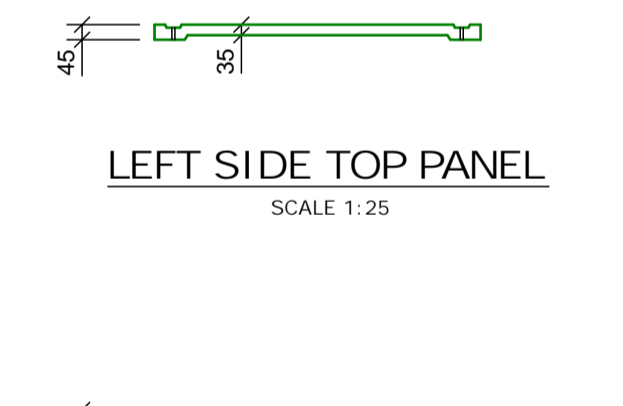


LEFT SIDE MIDDLE PANEL  
SCALE 1:25

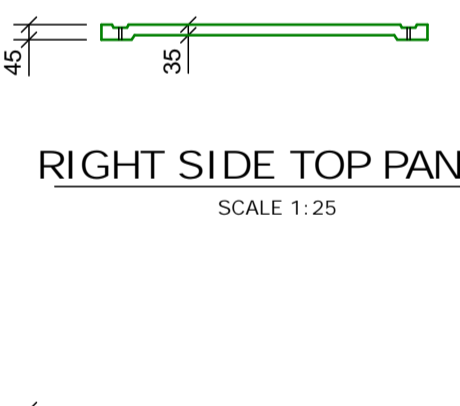


RIGHT SIDE MIDDLE PANEL  
SCALE 1:25

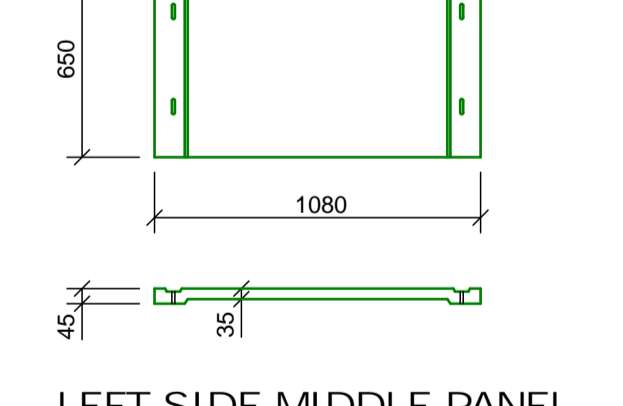


LEFT SIDE BOTTOM PANEL  
SCALE 1:25

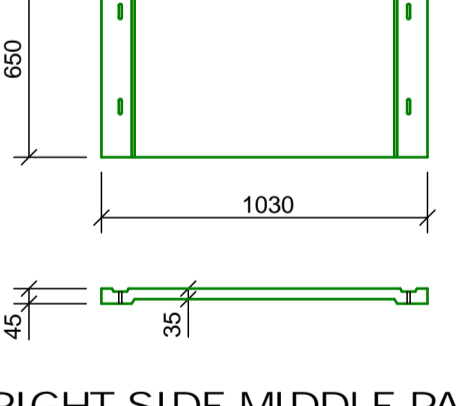


RIGHT SIDE BOTTOM PANEL  
SCALE 1:25

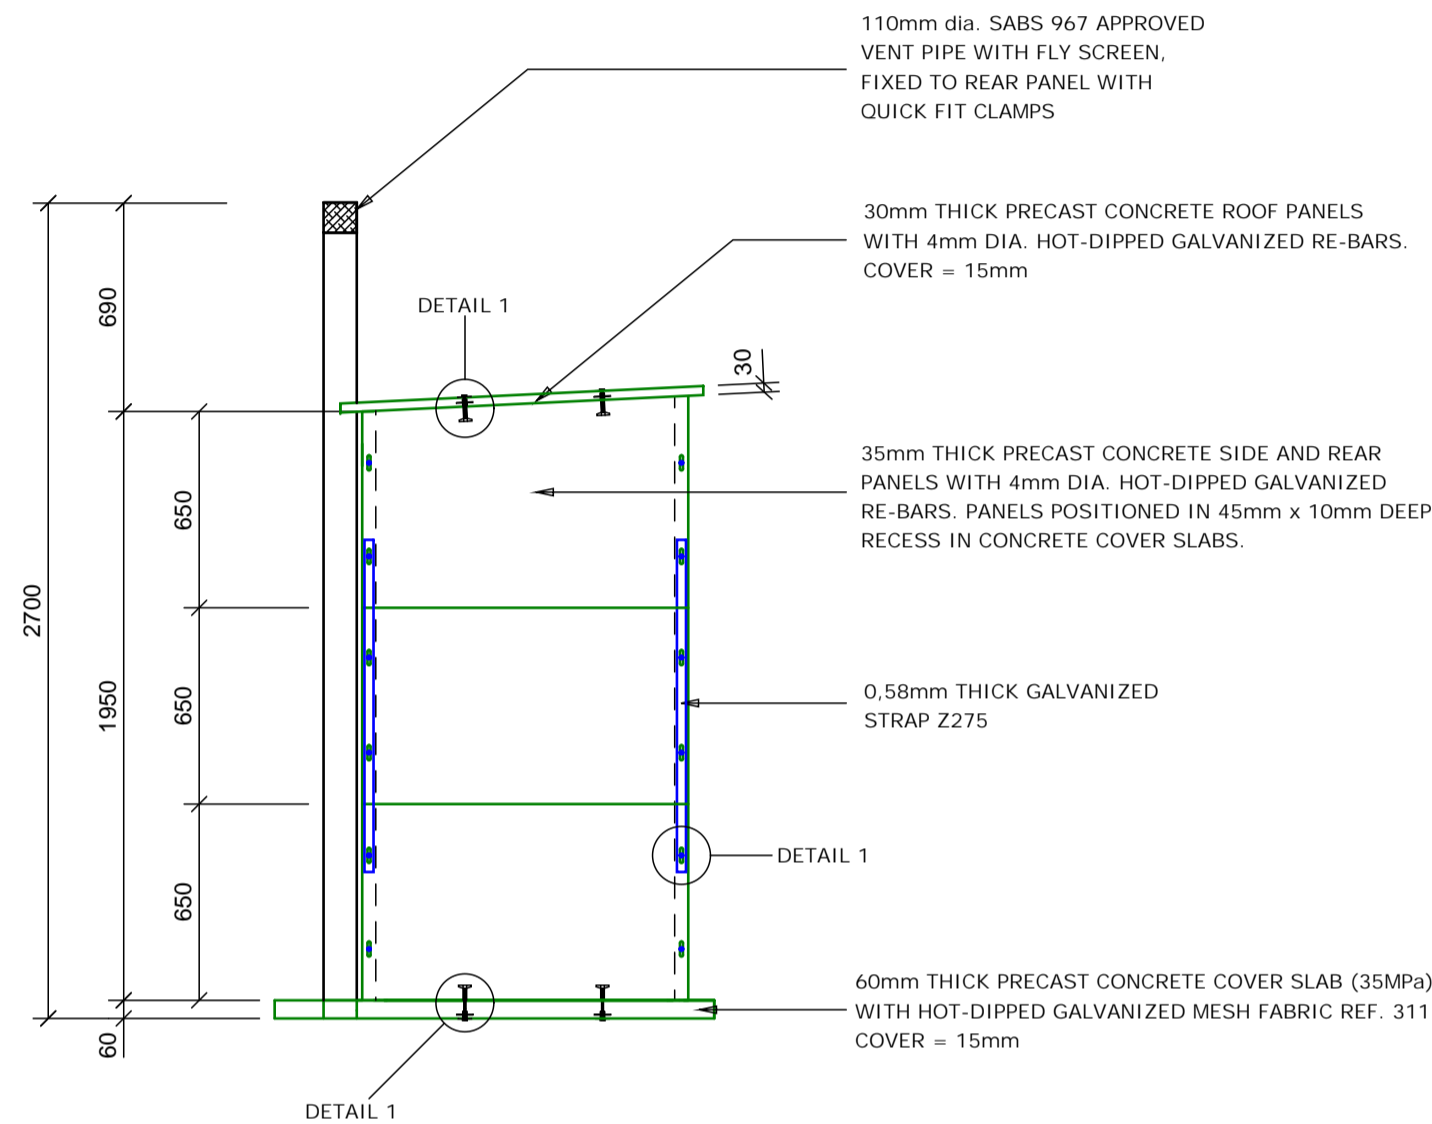


LEFT SIDE VIEW  
SCALE 1:25

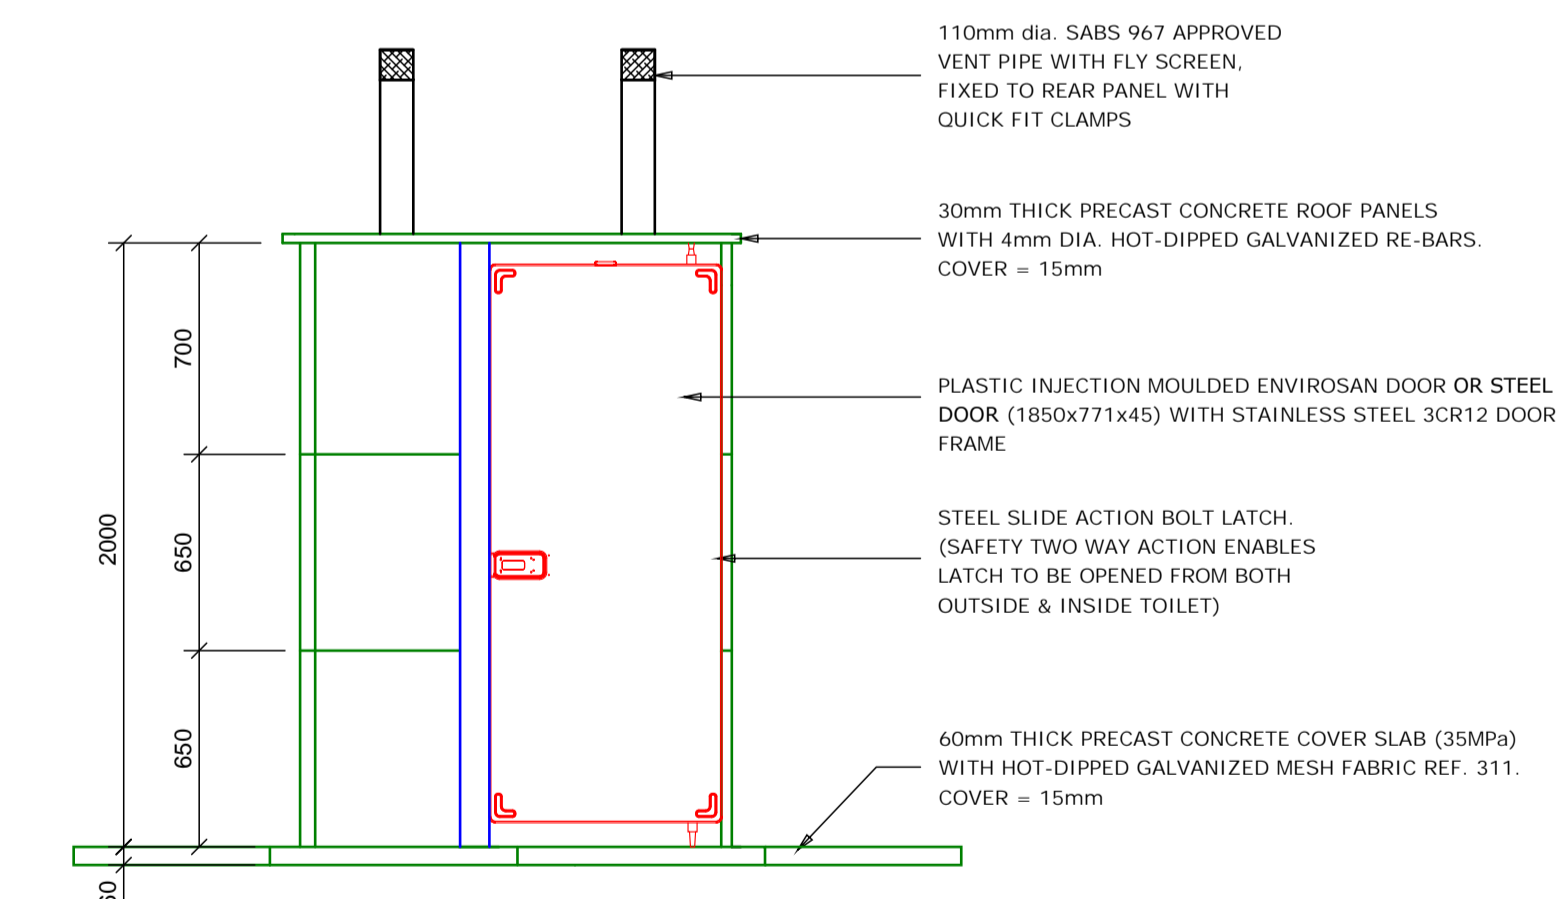


FRONT VIEW  
SCALE 1:25

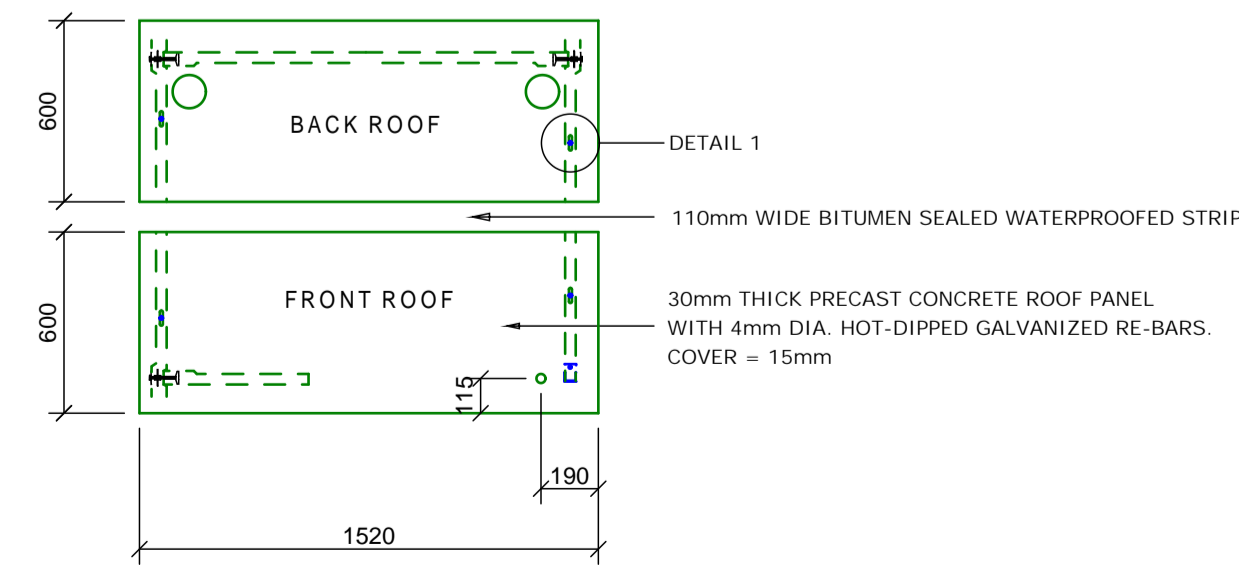


ROOF PANELS  
SCALE 1:25

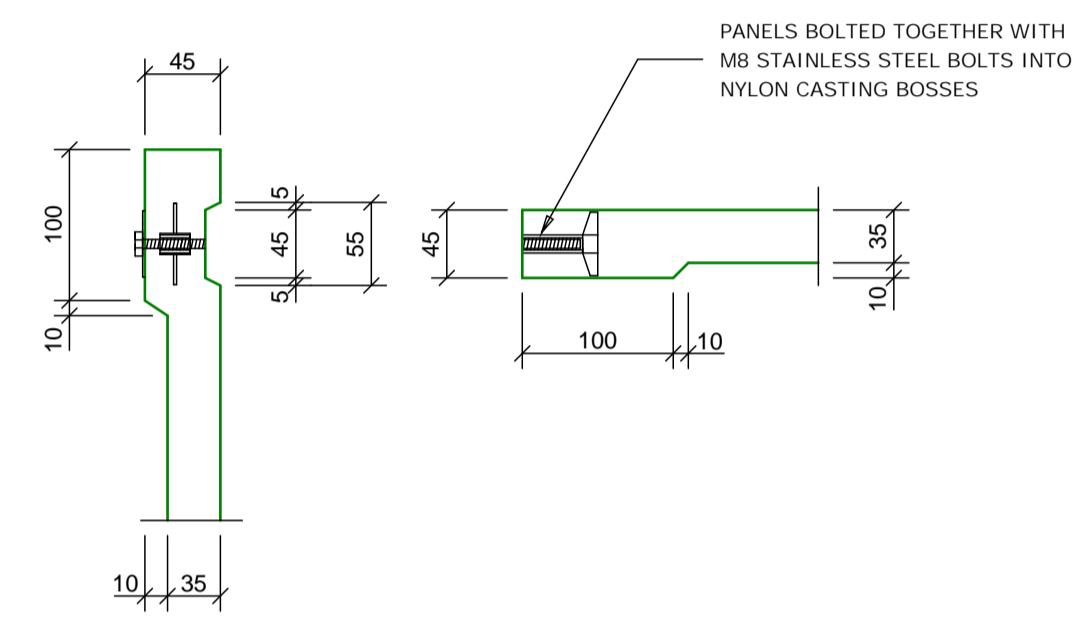


DETAIL 1  
SCALE 1:5

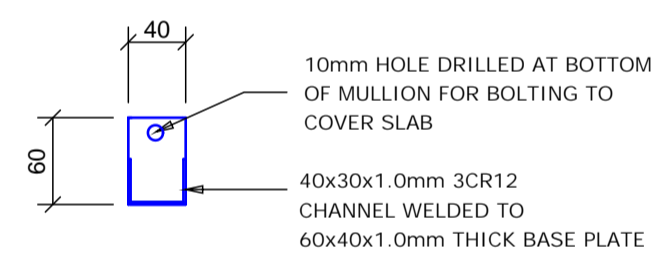


DETAIL 2  
SCALE 1:5

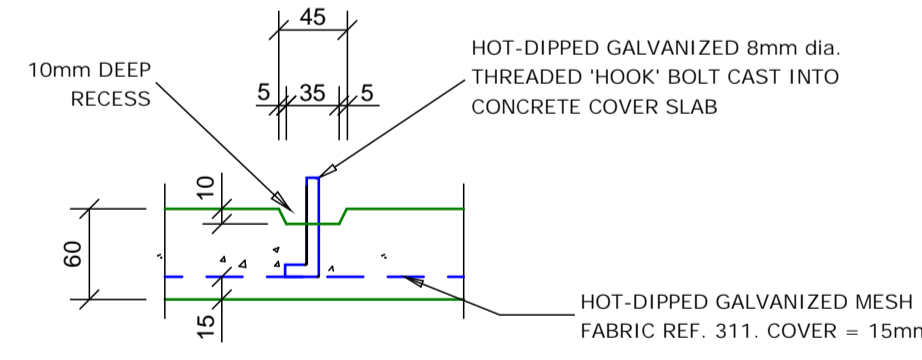


DETAIL 3  
SCALE 1:5

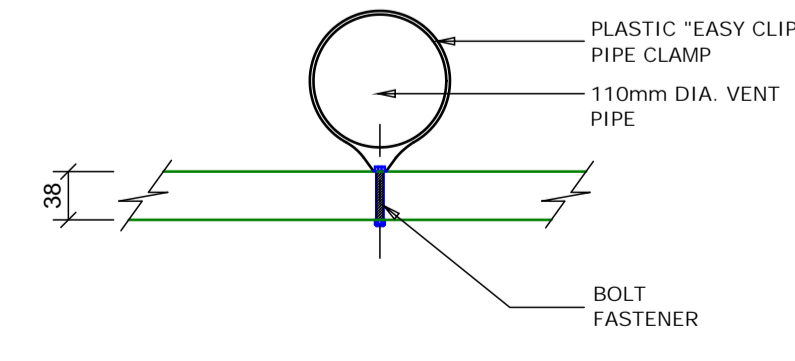

PIPE CLAMP  
DETAIL  
SCALE 1:5

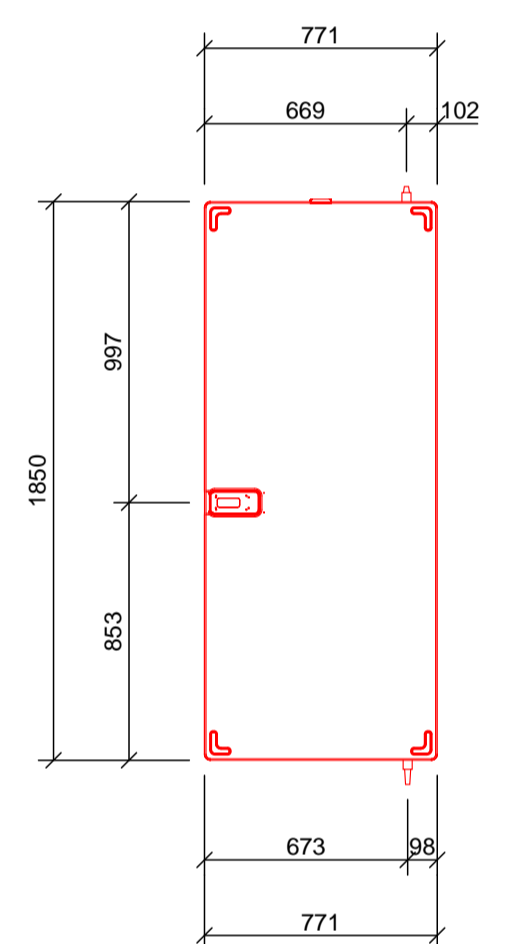

FRONT OF DOOR  
SCALE 1:25

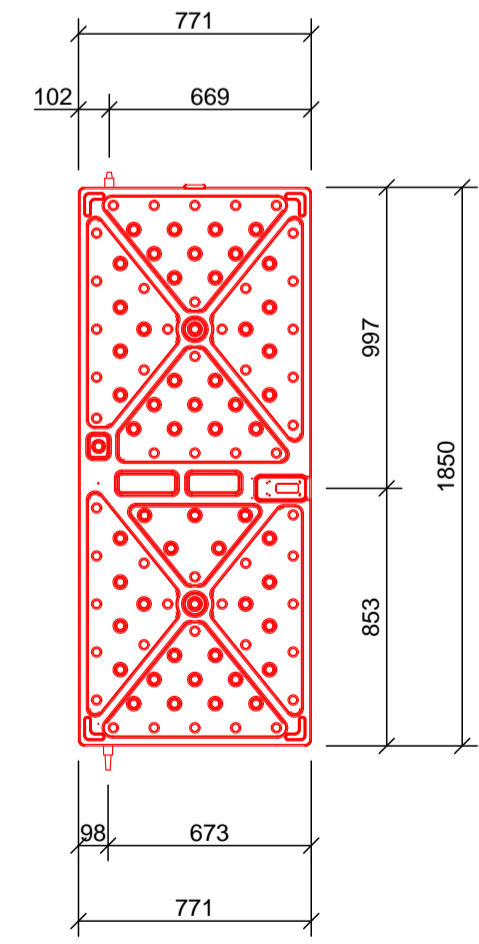

BACK OF DOOR  
SCALE 1:25

REVISION		
REV No	REV DATE	REVISION DESCRIPTION

- NOTES:
1. THE TYPE OF PIT LINING DEPENDS ON SITE CONDITIONS TO BE ASSESSED BY THE ENGINEER ON SITE.
  3. BRICK LINING CONSISTS OF SEMI-FACE BRICKS WITH A MINIMUM COMPRESSIVE STRENGTH = 14MPa. HOT-DIPPED GALVANIZED BRICKFORCE EVERY THIRD COURSE.
  4. NOTE THAT NO 75mm OPENINGS ARE PERMITTED WITHIN THE FIRST 510mm OF LINING BELOW GROUND LEVEL.
  5. ALL CONCRETE PRECAST ITEMS TO BE 35MPa.
  6. ALL OTHER CONCRETE APPLICATIONS TO BE 25MPa.
  7. MORTAR SHALL BE 5 PARTS SAND TO 1 PART CEMENT.
  8. MORTAR TO BE DRY MIXED UNTIL OF UNIFORM COLOUR AND WHOLE TURNED UNTIL THOROUGHLY AND EVENLY MIXED.
  9. MORTAR SHALL BE FRESHLY MIXED AND MORTAR WHICH HAS BEGUN TO SET SHALL NOT BE USED.
  10. MORTAR SHALL BE MIXED BY HAND. SPECIAL CARE TO BE TAKEN TO REMOVE ANY OLD MORTAR WHICH HAS ALREADY SET BEFORE COMMENCING TO MIX A FRESH BATCH.
  11. MORTAR JOINTS SHALL NOT EXCEED 10mm THICKNESS AND BLOCK COURSING SHALL BE SET OUT USING A PROPER GAUGE ROD.
  12. ALL STEEL MESH REINFORCEMENT TO BE HOT-DIPPED GALVANIZED.
  13. DOOR & FRAME TO BE STAINLESS STEEL 3CR12
  14. CONTRACTOR TO INSTALL 100mm WIDE BITUMEN SEALED WATERPROOF STRIP & ENSURE INTEGRITY

CLIENT  

**HARRY GWALA MUNICIPALITY DISTRICT**

PROJECT TITLE  
**APPOINTMENT OF SERVICE PROVIDER TO SUPPLY AND DELIVER VIP STRUCTURES**

DRAWING TITLE  
**STRUCTURAL DETAILS**

CHECKED	SCALE
APPROVED	AS SHOWN ON DRAWING
DESIGNED BY	DESIGN DATE
	8 MAY 2015
DRAWING No. 001	REVISION No. 3